




| MINIMUM SIDEWALK WIDTHS | |
|-------------------------|-------------|
| 5' | RESIDENTIAL |
| 6' | COMMERCIAL |

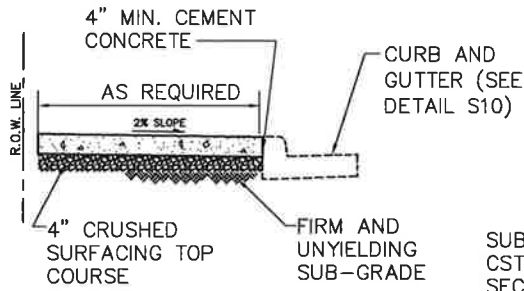

TYPICAL SECTION

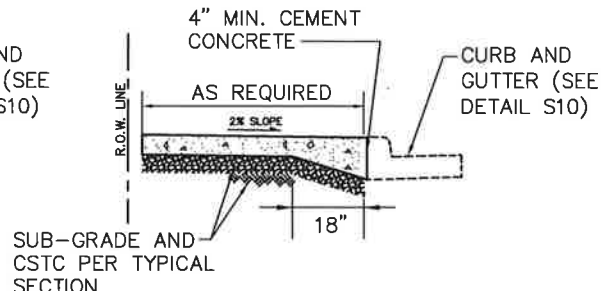


SECTION AT INTERSECTIONS

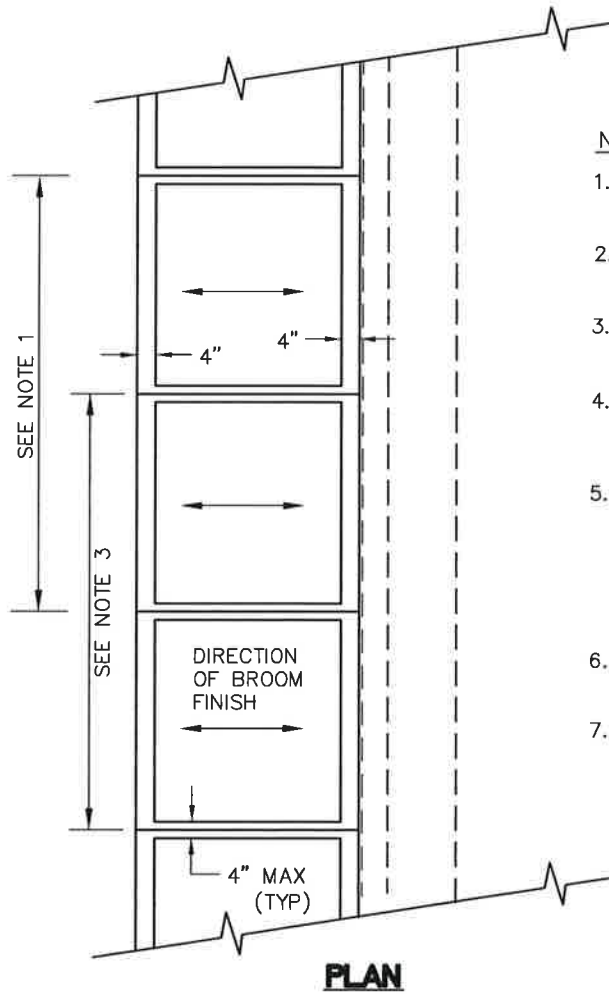

PLAN


NOTES:

1. EXPANSION JOINTS SHALL BE 1/4" x FULL DEPTH. ASPHALT SATURATED FELT PLACED AT 10' o.c.
2. NO EXPANSION JOINT SHALL BE INSTALLED BETWEEN SIDEWALK AND CURB.
3. DUMMY JOINTS SHALL BE 1" DEEP AND 1/4" WIDE PLACED AT 10' o.c.
4. ALL JOINTS SHALL BE CLEAN AND EDGED TO A 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
5. ALL UTILITY POLES AND STREET SIGN POSTS IN SIDEWALK AREA NOT REQUIRED TO BE RELOCATED BY THE CITY ENGINEER SHALL HAVE A SQUARE SECTION OF CONCRETE SURROUNDED BY 1/4" EXPANSION JOINT MATERIAL AROUND THE POLE. THE JOINT SHALL BE NO CLOSER THAN 6" TO ANY SIDE OF THE POLE.
6. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
7. CONCRETE SHALL BE CLASS 3000
3000 PSI 5-1/2 SACK WITH 6% AIR
COARSE AGGREGATE GRADING NO. 2
FINE AGGREGATE CLASS 1

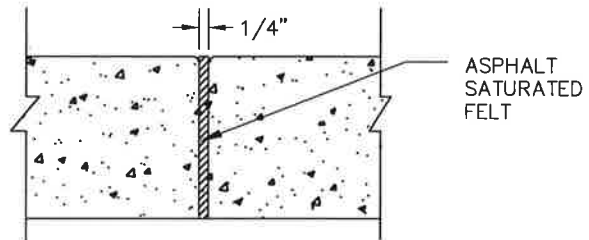

TYPICAL EXPANSION JOINT

Approved: *[Signature]* March 16, 2018
 City Engineer Date
STREET STANDARD DETAIL



Dwg No: **S8**
CEMENT CONCRETE SIDEWALK