

FINISHED GRADE
OR SUBGRADE

COMPACTED BACKFILL, SEE DETAIL SS7

SPECIAL PRECAUTIONS TO
PROTECT PIPE TO THIS LEVEL

3" MIN. WIDTH FLOURESCENT
ORANGE IDENTIFICATION TAPE
"NON-POTABLE WASTEWATER"
TO RUN CONTINUOUS WITH PIPE


PIPE ZONE BACKFILL, SEE
DETAIL SS7

TRACER WIRE FOR PVC PIPE

DUCTILE IRON, HDPE
OR PVC SEWER PIPE

FOUNDATION GRAVEL
AS REQUIRED

FIRM AND UN-YIELDING SUB-GRADE

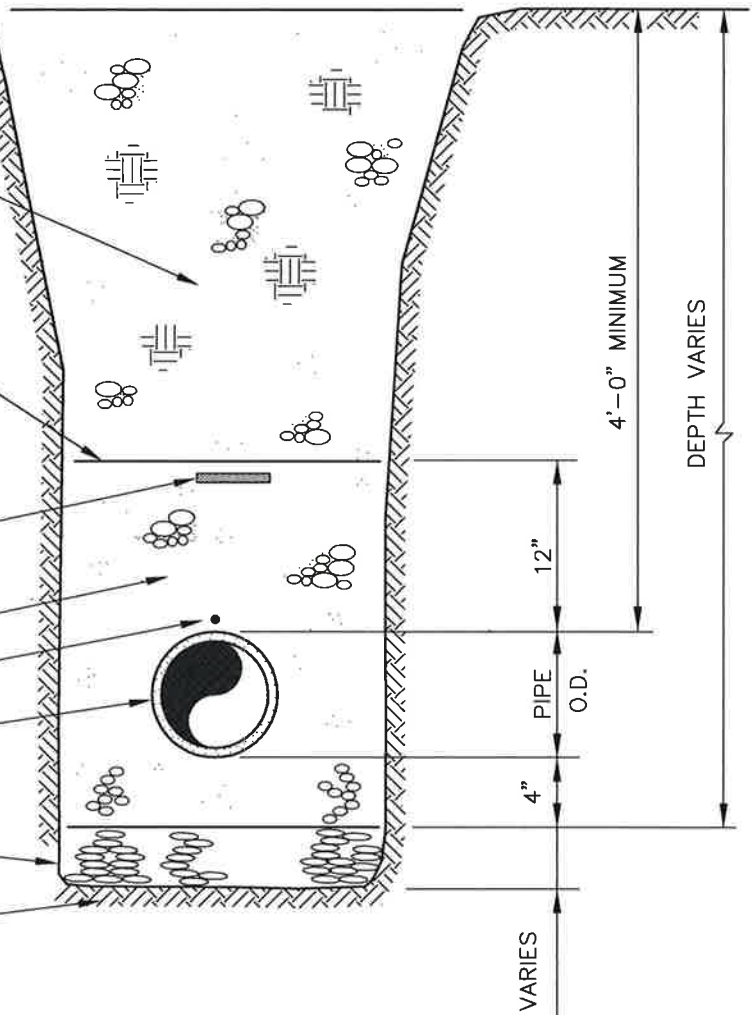

NOTE:

TRACER WIRE (10 GA) SHALL BE TERMINATED IN A
MANHOLE, VAULT, OR OTHER APPROVED LOCATION
ON A TERMINAL BLOCK WITHIN 18" OF THE LID OR
RIM OF THE STRUCTURE.

Approved:

March 16, 2018

City Engineer

Date

SANITARY SEWER STANDARD DETAIL



Dwg No:

SS8

**PRESSURE LINE AND FORCE
MAIN TRENCH SECTION**