




MINIMUM SIDEWALK WIDTHS	
5'	RESIDENTIAL
6'	COMMERCIAL

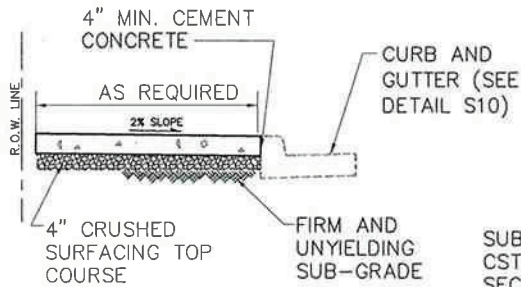

TYPICAL SECTION

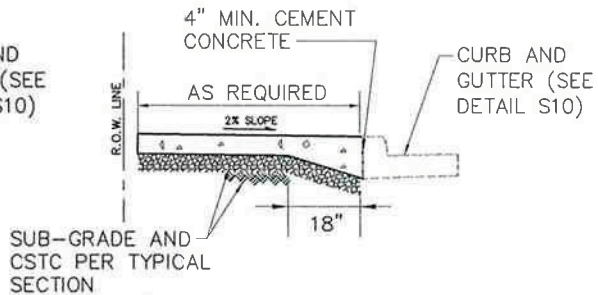

SECTION AT INTERSECTIONS

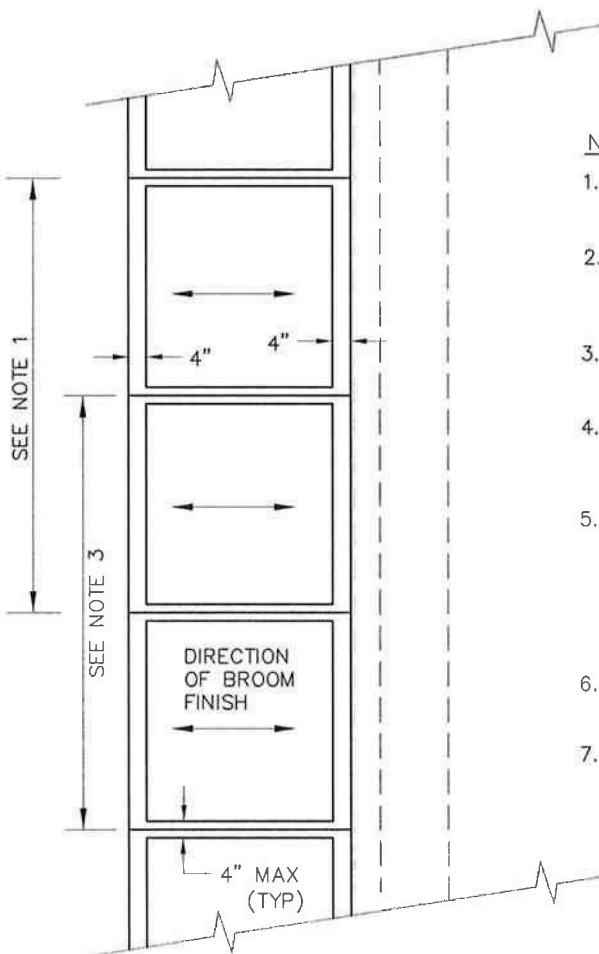

PLAN

NOTES:

1. EXPANSION JOINTS SHALL BE 1/2" x 2". ASPHALT SATURATED FELT PLACED AT 10' o.c.
2. THRU JOINTS SHALL BE 1/2" x 4". ASPHALT SATURATED FELT PLACED AT DRIVEWAYS, ALLEY RETURNS AND WHEELCHAIR RAMPS.
3. DUMMY JOINTS SHALL BE 1" DEEP AND 1/4" WIDE PLACED AT 10' o.c.
4. ALL JOINTS SHALL BE CLEAN AND EDGED TO A 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
5. ALL UTILITY POLES AND STREET SIGN POSTS IN SIDEWALK AREA NOT REQUIRED TO BE RELOCATED BY THE CITY ENGINEER SHALL HAVE A SQUARE SECTION OF CONCRETE SURROUNDED BY 1/2" EXPANSION JOINT MATERIAL AROUND THE POLE. THE JOINT SHALL BE NO CLOSER THAN 6" TO ANY SIDE OF THE POLE.
6. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
7. CONCRETE SHALL BE CLASS 3000 3000 PSI 5-1/2 SACK WITH 6% AIR COARSE AGGREGATE GRADING NO. 2 FINE AGGREGATE CLASS 1

2	Clarified 4" CSTC	5/11/09
1	Removed 15' O.C. Note	9/28/06
Rev No.	Revisions	Date

Approved:  June 17, 2005
 City Engineer Date

STREET STANDARD DETAIL



Dwg No. **S8**
CEMENT CONCRETE SIDEWALK