
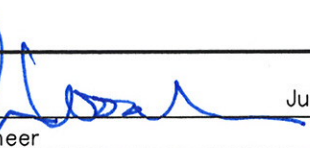


NOTE:

1. TRENCH SHALL BE BACKFILLED AND COMPACTED IN ACCORDANCE WITH WSDOT 7-08.3(3).
2. BEDDING MATERIAL SHALL BE PEA GRAVEL OR APPROVED EQUAL. PIPE ZONE BACKFILL SHALL BE PEA GRAVEL (OR APPROVED EQUAL) TO THE SPRING LINE FOR DUCTILE IRON PIPE AND TO A DEPTH OF 6" ABOVE THE CROWN FOR PVC PIPE AS SHOWN ABOVE.

Approved:  June 17, 2005
 City Engineer Date
SANITARY SEWER STANDARD DETAIL



Dwg No: **SS7**
SANITARY SEWER
TRENCH SECTION