


NOTES:

1. SURROUND SERVICE WITH 8" OF SAND PER 9-03.1(2) AND BACKFILL PER DETAIL W2.
2. METERS SHALL BE INSTALLED BY THE CITY OF BONNEY LAKE.
3. INDIVIDUAL PRESSURE REDUCING VALVE (WASHINGTON STATE DEPARTMENT OF HEALTH APPROVED) IS REQUIRED.

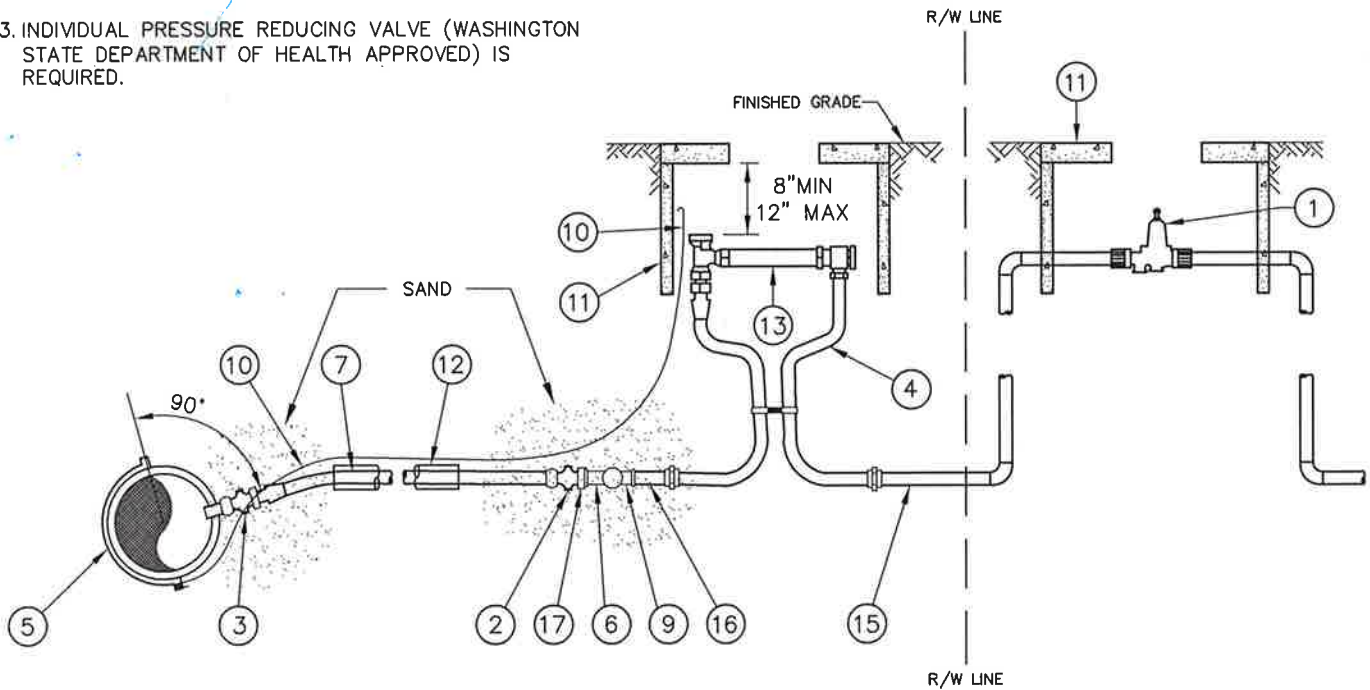

Approved:

City Engineer

June 17, 2015

Date

WATER STANDARD DETAIL



Dwg No:

**W10 - RCounty
RESIDENTIAL
WATER SERVICE**

W10-RCounty RESIDENTIAL WATER SERVICE

LEGEND

- ① INDIVIDUAL PRESSURE REDUCING VALVE - SEE DETAIL W23.
- ② FORD B61-444-G-NL (1" FEMALE IRON PIPE THREAD X PACK JOINT BALL VALVE WITH STAINLESS STEEL STIFFENER).
- ③ FORD F1101 (1" MALE IRON PIPE THREAD X PACK JOINT CORP STOP WITH STAINLESS STEEL STIFFENER).
- ④ COPPER SETTER WITH FIBER GASKETS SHALL BE VBH72-12W WITH FORD C86-33.
- ⑤ ROMAC SADDLE SINGLE STRAP FOR PIPE DIAMETERS LESS THAN 8" AND DOUBLE STRAP FOR PIPE DIAMETERS 8" AND GREATER.
- ⑥ 1" X 3/4" X 3/4" BRASS TEE.
- ⑦ 1" HIGH MOLECULAR (200 PSI) SIDR7 POLYETHYLENE PIPE (LENGTH AS REQUIRED).
- ⑧ 3/4" BRASS NIPPLE (12" LENGTH).
- ⑨ 3/4" BRASS 90° ELBOW WITH BRASS NIPPLES.
- ⑩ 10 GAUGE INSULATED SOLID CORE COPPER TRACER WIRE. STRIP 12" AND WRAP AROUND SADDLE ASSEMBLY BOLT. STRIP 6" MINIMUM INSIDE BOX (RUN INSIDE 2" PVC SLEEVE WHERE APPLICABLE).
- ⑪ METER BOX - SEE DETAIL W1.
- ⑫ INSTALL SERVICE LINE IN 2" PVC SCHEDULE 40 SLEEVE WHEN CROSSING ROADWAY (6' MIN. BEYOND BACK OF CURB UNLESS OTHERWISE APPROVED BY THE CITY). CLEARANCE BETWEEN SLEEVE AND BALL VALVE SHALL BE 2' MINIMUM.
- ⑬ 3/4" BRASS NIPPLE.
- ⑭ PROVIDE APPROVED WATERTIGHT PLUG UNTIL CONNECTION TO PRIVATE SYSTEM OWNER WHERE APPLICABLE.
- ⑮ 3/4" BRASS NIPPLE OR 3/4" HIGH MOLECULAR (200 PSI) SIDR7 POLYETHYLENE AS APPLICABLE DEPENDING ON LOCATION OF PRV.
- ⑯ 3/4" BRASS NIPPLE (6" LENGTH).
- ⑰ 1" BRASS CLOSE NIPPLE.

PAGE 2 OF 2

Approved:

June 17, 2015

City Engineer

Date

WATER STANDARD DETAIL



Dwg No:

W10 - RCounty

**RESIDENTIAL
WATER SERVICE**